

MYERS POWER PRODUCTS, INC.
 2950 E. PHILADELPHIA ST. ONTARIO, CA. 91761-8545

CAT. NO. MEUG16-M100-AZ
 SEE DRAWING 5005890-SP FOR WIRING DIAGRAM
120/240 V 1 ϕ 3 W 100 AMPS
 UTILITY SRP/APS 22K AIC
 DISTRIBUTOR JTB SUPPLY
 CONTRACTOR _____

FINISH COLOR LT. GREEN WHITE DK. GREEN
 OTHER

STATE INSPECTION REQUIRED YES NO

U.L. LABEL
 INDUSTRIAL CONTROL
 CABINET & BOXES

NAMEPLATES BREAKER I.D.
 PHENOLIC CONTRACT NO. _____


PHOTOCELL REQUIRED YES NO PHOTOCELL PROVISIONS YES NO

MYERS METERED UNDERGROUND SERVICE PEDESTAL
 NEMA 3R CONSTRUCTION- -STAINLESS STEEL HARDWARE
 12ga. GALVANEALD STEEL W/POWDER COAT FINISH.

ALL FACTORY WIRING CODE GAUGE COPPER CONDUCTORS WITH 600V INSULATION
 SERVICE TERMINATIONS NO. 6 AWG TO 250 MCM CU/AL

MATERIAL LIST

NO	DESCRIPTION	QTY	AMP	POLE	KAIC		MYERS P/N
	SERV. DISC.	1	100	2	22K	BRH2100	G21115
	SUB BREAKERS AS INDICATED				10K	CUTLER-HAMMER TYPE BR	
PE	PHOTOELECTRIC	1	15	1	120V	TDRK	056003
HDA	SELECTOR SWITCH	1	10	3PDS	120V	A-B#800F	051039
C	CONTACTOR, EH	1	30	3	120V	GE#EF65A300B110	Y23156

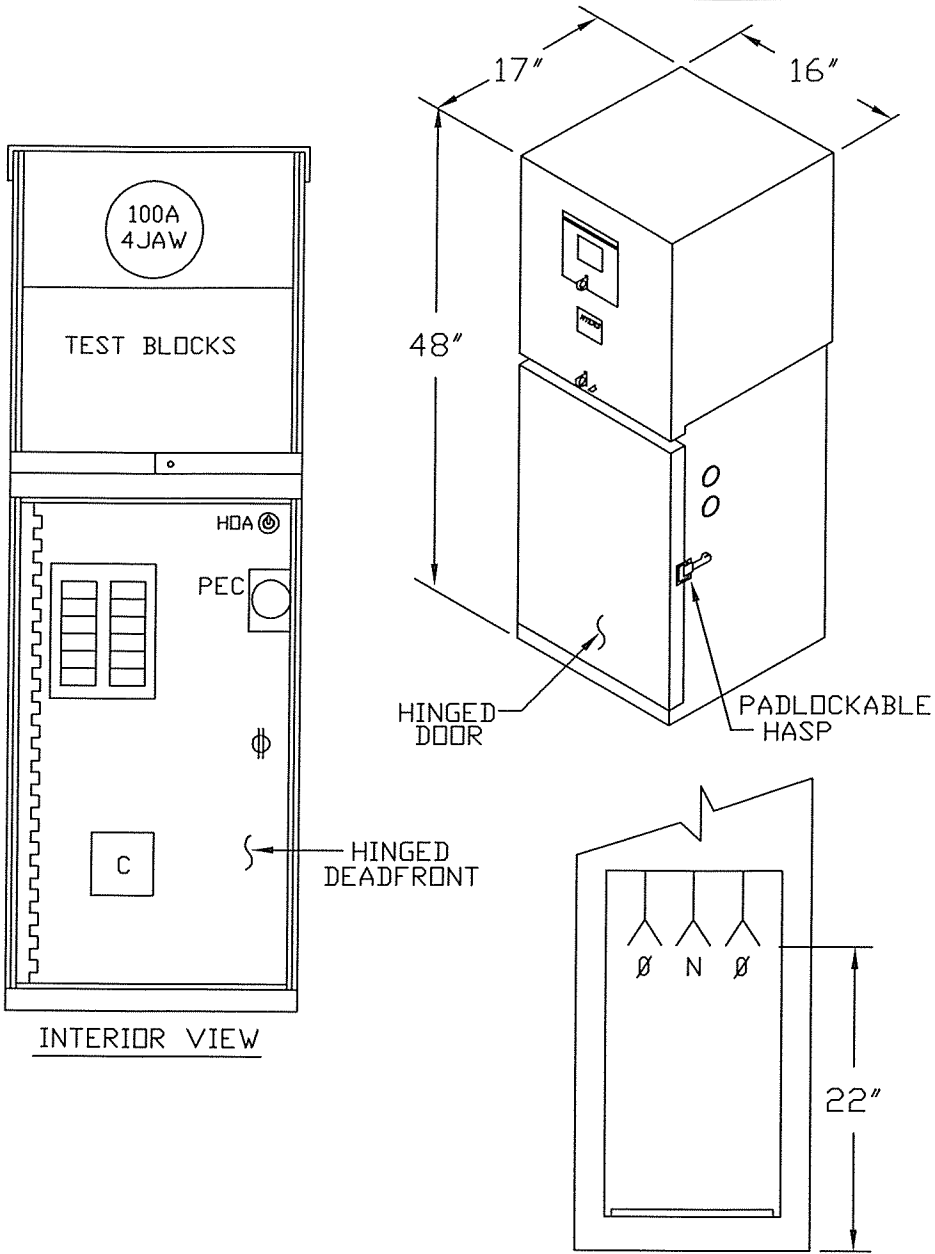

REAR LANDING DETAIL, COVER REMOVED

FOR BASE DETAILS SEE MYERS CATALOG. QTY. _____

DATE: 10/18/19 BY: JLT S/O# SM122038 F5005890-SP